




Fire Detection in Duisburg

H. I. WILLMS, H. LUCK, W. KRÜLL & T. SCHULTZE
Department of Communication Systems

UNIVERSITÄT
DUISBURG
ESSEN

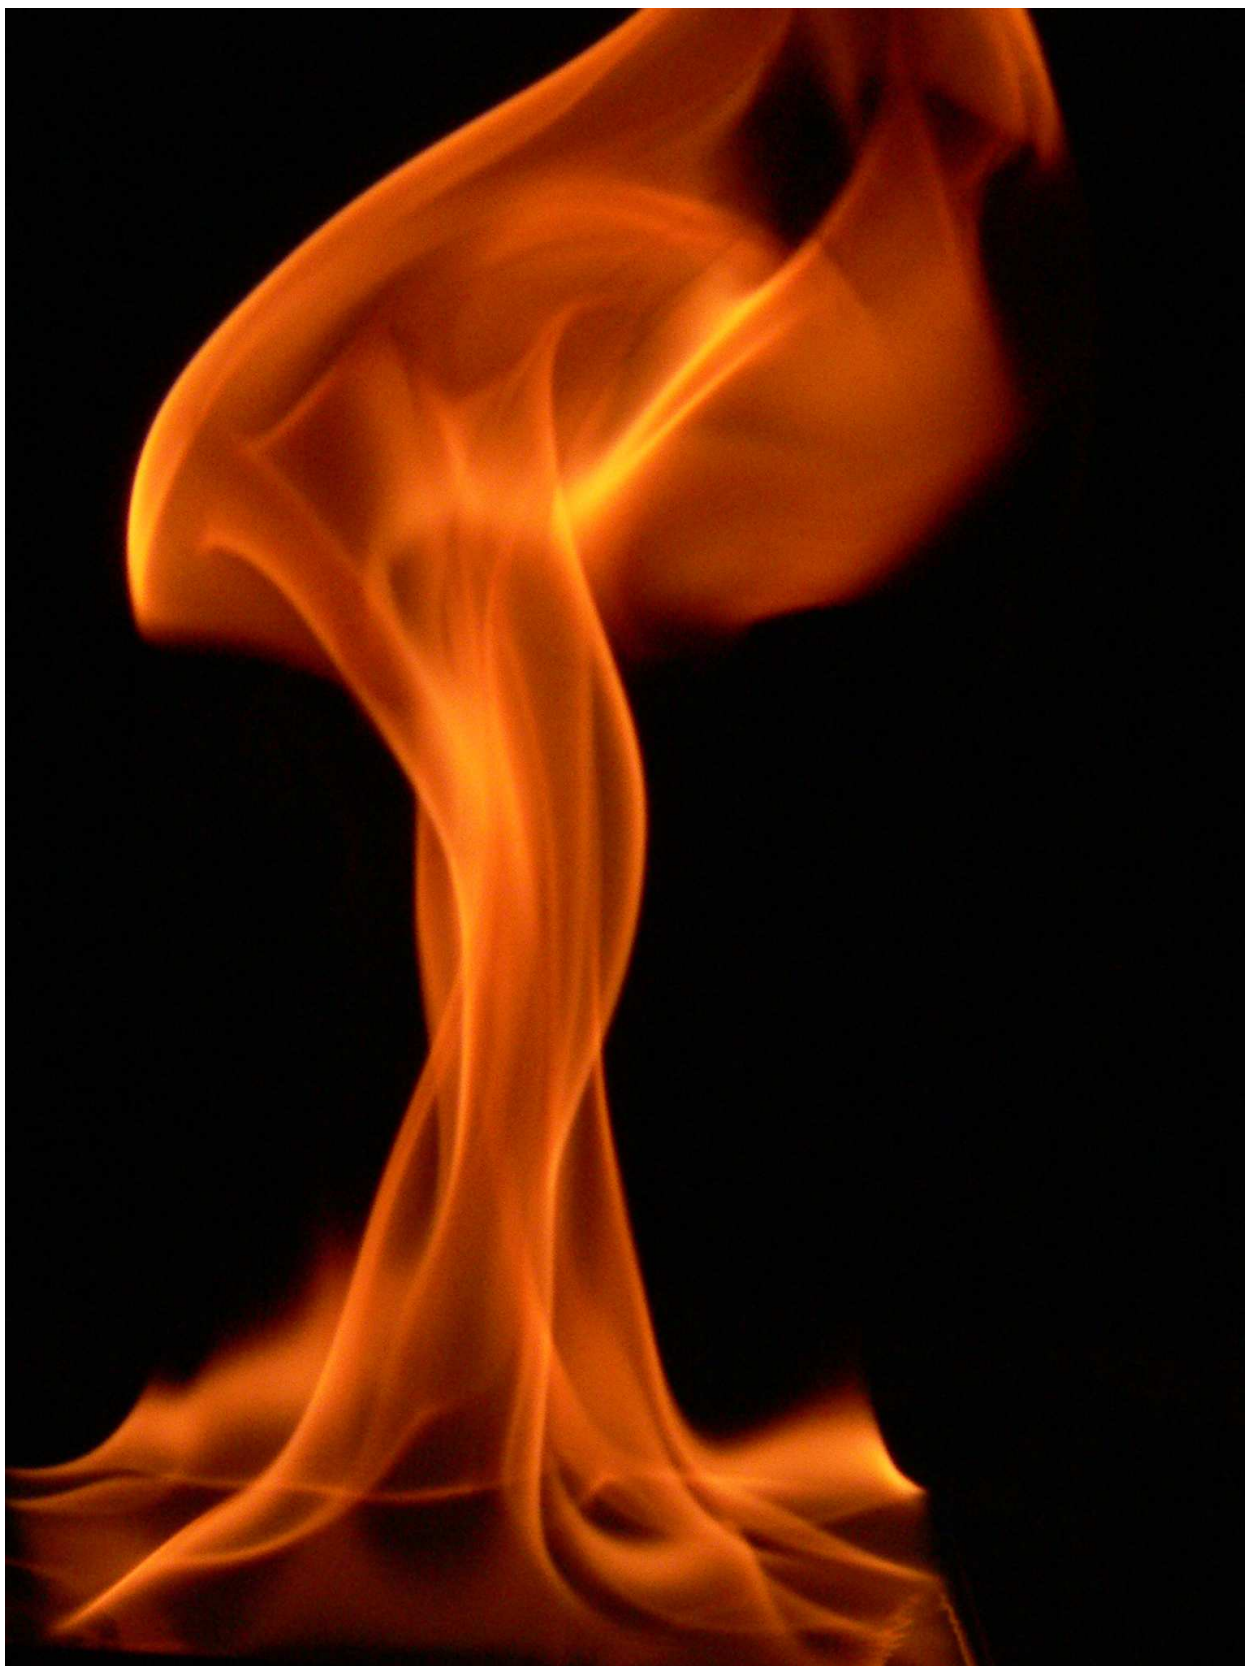

**Flaming liquid fire TF 7 (decalene) defined by the
European Standard EN 54 part 7 for testing fire detectors**